

This series of control sequences provides single duct bypass variable air volume cooling with up to three stages of electric or hot water reheat. As space temperature drops, airflow to the zone is reset from full open to the minimum airflow setpoint. As space temperature continues to drop, reheat is energized in stages to satisfy the load. The minimum airflow setpoint is field calibrated by adjusting the damper linkage. The maximum airflow setpoint is obtained through adjustment of an upstream damper provided by others.

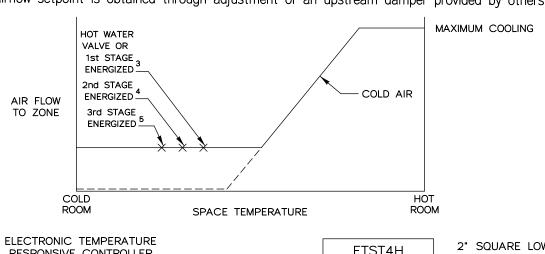

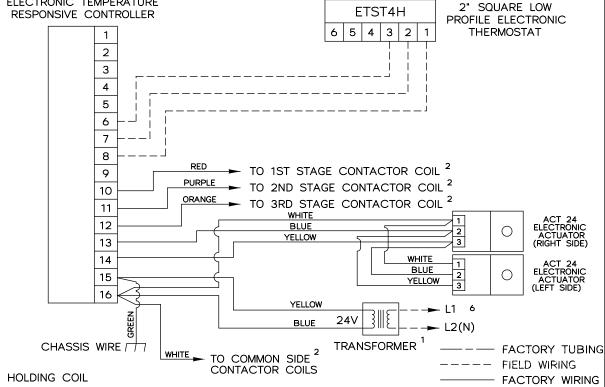

¹ MINIMUM 40 VA

² MAXIMUM 10 VA HOLDING COIL

³ ENERGIZED 2° F BELOW SETPOINT

⁴ ENERGIZED 3° F BELOW SETPOINT

⁵ ENERGIZED 4° F BELOW SETPOINT

FELECTRIC HEAT IS PROVIDED,
TRANSFORMER IS LOCATED IN HEATER
ENCLOSURE- REFER TO HEATER
WIRING DIAGRAM.

IF HOT WATER REHEAT IS USED, FIELD WIRING IS REQUIRED.

SEQ. NO.	CONTROLLER NO.	HEAT STAGES	NOTES
BT602SB	ETRD\\(02	0	_
BT604SB	ETRD12	1	7
BT606SB	ETRD22	2	_
BT608SB	ETRD32	3	_

BT602, BT604, BT606 & BT608 SB

TEMPERATURE RESPONSIVE

DRAWING NO:

DRAWN BY: WDD DATE: 04/06/00 REV NO: O1 REV DATE: 09/19/00 APPROVED BY: W.E.

SIZES 10 THROUGH 18

20829