
This series of control sequences provides intermittent fan powered variable air volume control with up to three stages of electric or hot water heat and morning warm up/changeover. As space temperature drops, primary airflow is reset from maximum to minimum setpoint. As space temperature continues to drop, the unit fan is energized thus supplying plenum air to the space. On a further drop in space temperature, heat is energized in stages to satisfy the load. When warm air is sensed by an electric duct sensor, the unit fan and heat are deenergized and the primary air valve reverses operation for morning warm up or summer/winter changeover. Air volume limits are located at the thermostat.

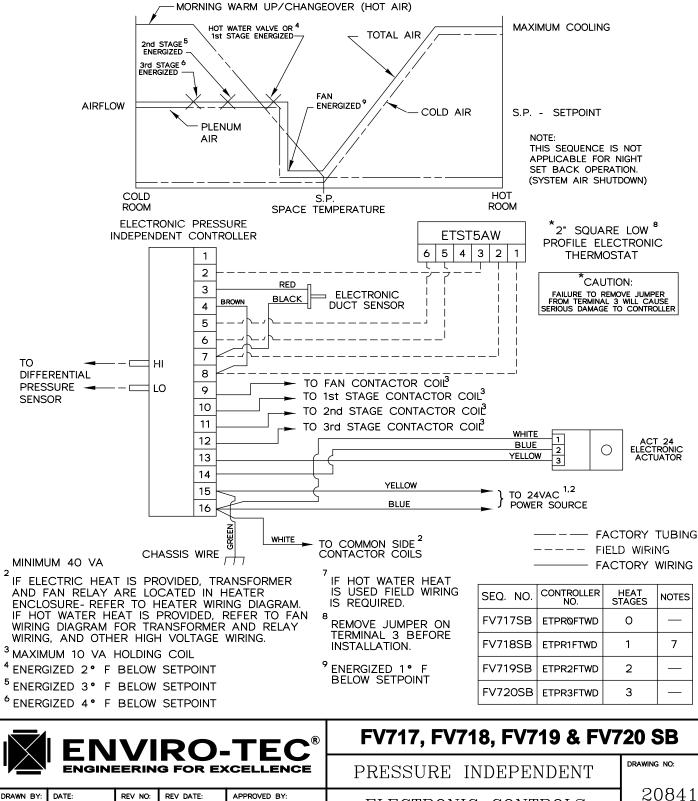

ELECTRONIC CONTROLS W.E.

04/06/00

00

WDD