
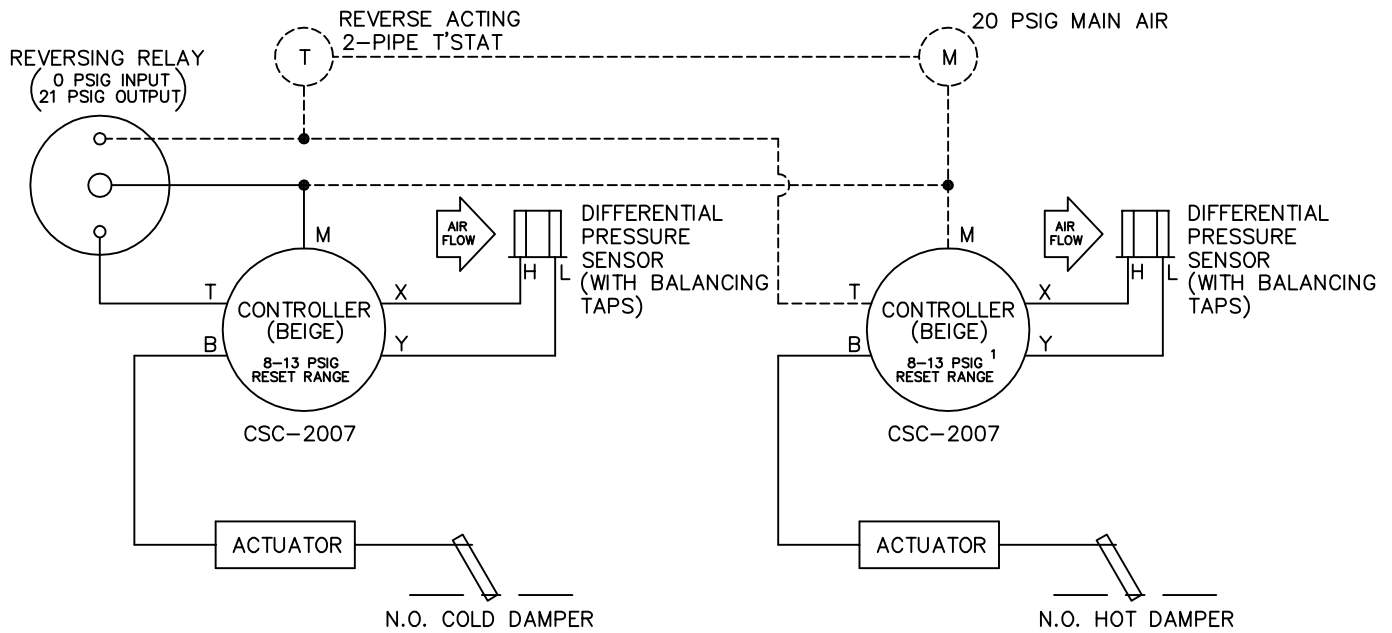


A reverse acting, two-pipe thermostat is required. Both dampers are normally open. Hot and cold decks are system pressure independent. Maximum heating and cooling air flow set points are constant. When the space temperature is warm, the cold damper is controlling at the maximum CFM setting and the hot damper is closed. As the space temperature drops, the cold damper modulates closed as the hot damper opens. If the space temperature continues to drop, the cold damper shuts off and the hot damper controls at the maximum CFM setting.

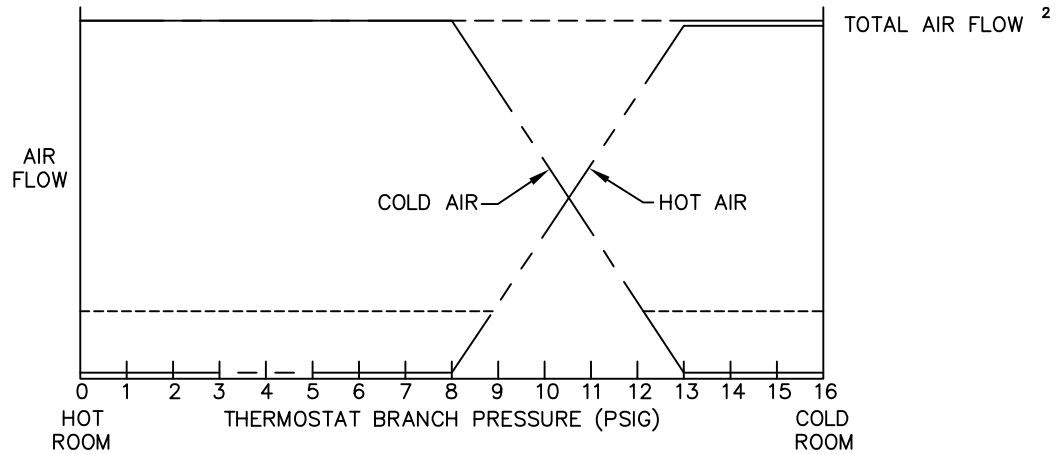

¹ CONTROLLER RESET RANGE WILL VARY WITH AIR FLOW LIMITS
² AIR VOLUME WILL DEVIATE FROM CONSTANT AIR FLOW DURING THE MIXING STAGE.

PNEUMATIC AIR CONSUMPTION 1.6 SCFH

——— FACTORY PIPING - - - - - FIELD PIPING

	TITLE:	DD406	DRN BY:	D.A.	DATE:	06/12/84	DRAWING NO.	10457
	PRESSURE INDEPENDENT PNEUMATIC CONTROLS		CKD BY:	WAE	DATE:	10/28/08	REV:	
<small>THIS DRAWING CONTAINS PROPRIETARY DATA. UNAUTHORIZED DISCLOSURE, REPRODUCTION, OR USE IS STRICTLY PROHIBITED WITHOUT WRITTEN PERMISSION</small>								

UNCONTROLLED WHEN PRINTED