


A reverse acting, two-pipe thermostat is required. Damper is normally open. The thermostat closes the damper on a drop in room temperature and opens the damper on a rise in room temperature. Maximum or minimum damper position is field calibrated by adjusting the damper linkage.

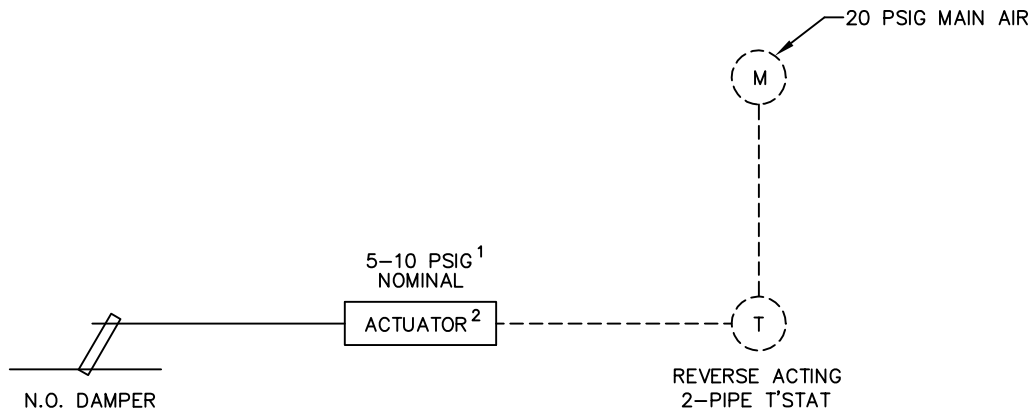

¹ NOMINAL SPRING RANGE IS FOR UNLOADED OPERATION. ACTUAL LOADED RANGE WILL VARY AND IS DEPENDENT ON MECHANICAL STOPS (IF UTILIZED). THIS SEQUENCE IS NOT RECOMMENDED FOR APPLICATIONS REQUIRING DIRECT SEQUENCING WITH OTHER CONTROL DEVICES. (i.e. DDC/PNEUMATIC CONTROL DEVICES BY OTHERS)

² UNIT SIZES 19 & 22 UTILIZE DUAL PNEUMATIC DAMPER ACTUATORS

—————FACTORY PIPING - - - - -FIELD PIPING



TITLE: **SD002R**
PRESSURE INDEPENDENT PNEUMATIC CONTROLS

THIS DRAWING CONTAINS PROPRIETARY DATA. UNAUTHORIZED DISCLOSURE, REPRODUCTION, OR USE IS STRICTLY PROHIBITED WITHOUT WRITTEN PERMISSION

DRN BY:
AWW

DATE:
08/27/93

DRAWING NO.

CKD BY:
WAE

DATE:
08/20/08

REV:
06

16347

UNCONTROLLED WHEN PRINTED